

FUJI Electric Co., Ltd

MICREX-SX Series

Computer Link Driver

Supported version TOP Design Studio V1.4.4 or higher



CONTENTS

We would like to thank our customers for using M2I's "Touch Operation Panel (M2I TOP) Series". Read this manual and familiarize yourself with the connection method and procedures of the "TOP and external device".

- 1. System configuration** [Page 2](#)

Describes the devices required for connection, the setting of each device, cables, and configurable systems.
- 2. External device selection** [Page 3](#)

Select a TOP model and an external device.
- 3. TOP communication setting** [Page 4](#)

Describes how to set the TOP communication.
- 4. External device setting** [Page 9](#)

Describes how to set up communication for external devices.
- 5. Cable table** [Page 10](#)

Describes the cable specifications required for connection.
- 6. Supported addresses** [Page 11](#)

Refer to this section to check the addresses which can communicate with an external device.

1. System configuration

The system configuration of TOP and "FUJI Electric Co., Ltd – MICREX-SX Series" is as follows:

Series	CPU	Link I/F	Communication method	Communication setting	Cable
MICREX-SX	SPH3000 SPH300 SPH2000 SPH200	CPU port	RS-232C	3. TOP communication setting 4. External device setting	5. Cable table
	NP1L-RS□ (General Purpose Communication Module)	RS-232C RS-485			

■ Connection configuration

- 1:1 (one TOP and one external device) connection




- 1:N (one TOP and multiple external devices) connection



2. External device selection

- Select a TOP model and a port, and then select an external device.

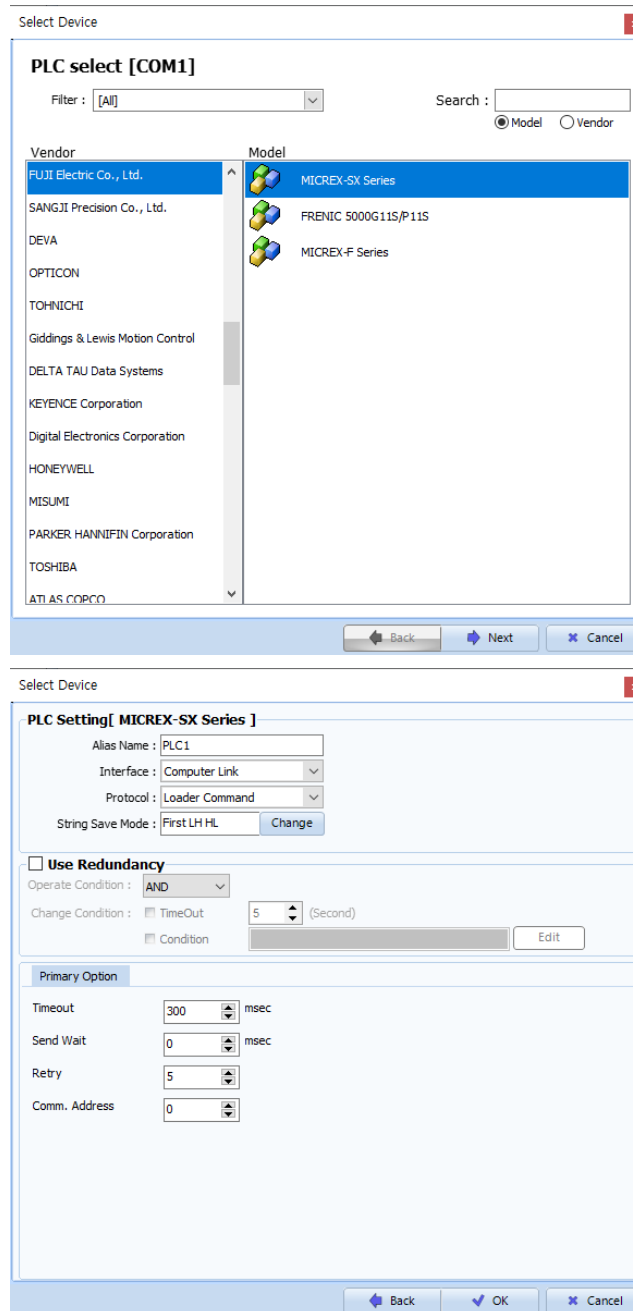

Settings		Contents					
TOP	Model	Check the TOP display and process to select the touch model.					
External device	Vendor	Select the vendor of the external device to be connected to TOP. Select "FUJI Electric Co., Ltd".					
	PLC	Select an external device to connect to TOP. <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Model</th> <th>Interface</th> <th>Protocol</th> </tr> </thead> <tbody> <tr> <td>MICREX-SX Series</td> <td>Computer Link</td> <td>Loader Command</td> </tr> </tbody> </table> <p>Please check the system configuration in Chapter 1 to see if the external device you want to connect is a model whose system can be configured.</p>	Model	Interface	Protocol	MICREX-SX Series	Computer Link
Model	Interface	Protocol					
MICREX-SX Series	Computer Link	Loader Command					




3. TOP communication setting

The communication can be set in TOP Design Studio or TOP main menu. The communication should be set in the same way as that of the external device.

3.1 Communication setting in TOP Design Studio

(1) Communication interface setting

- [Project > Project Property > TOP Setting] → [Project Option > "Use HMI Setup" Check > Edit > Serial]
- Set the TOP communication interface in TOP Design Studio.

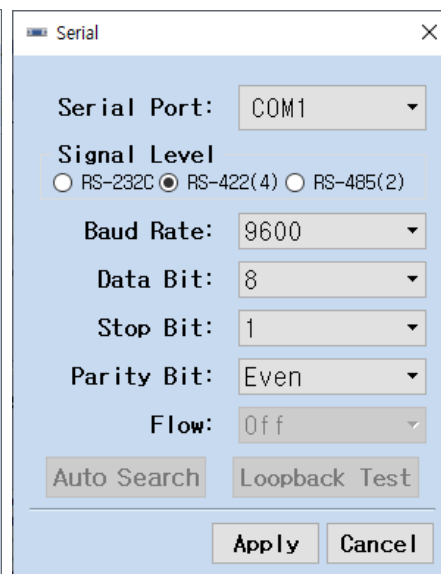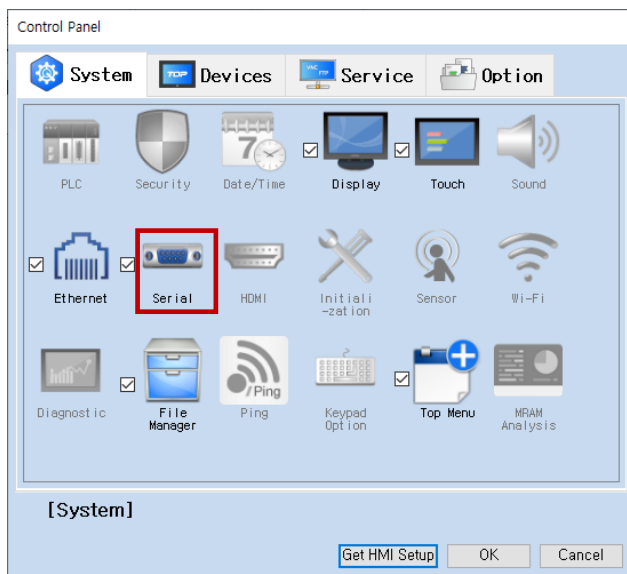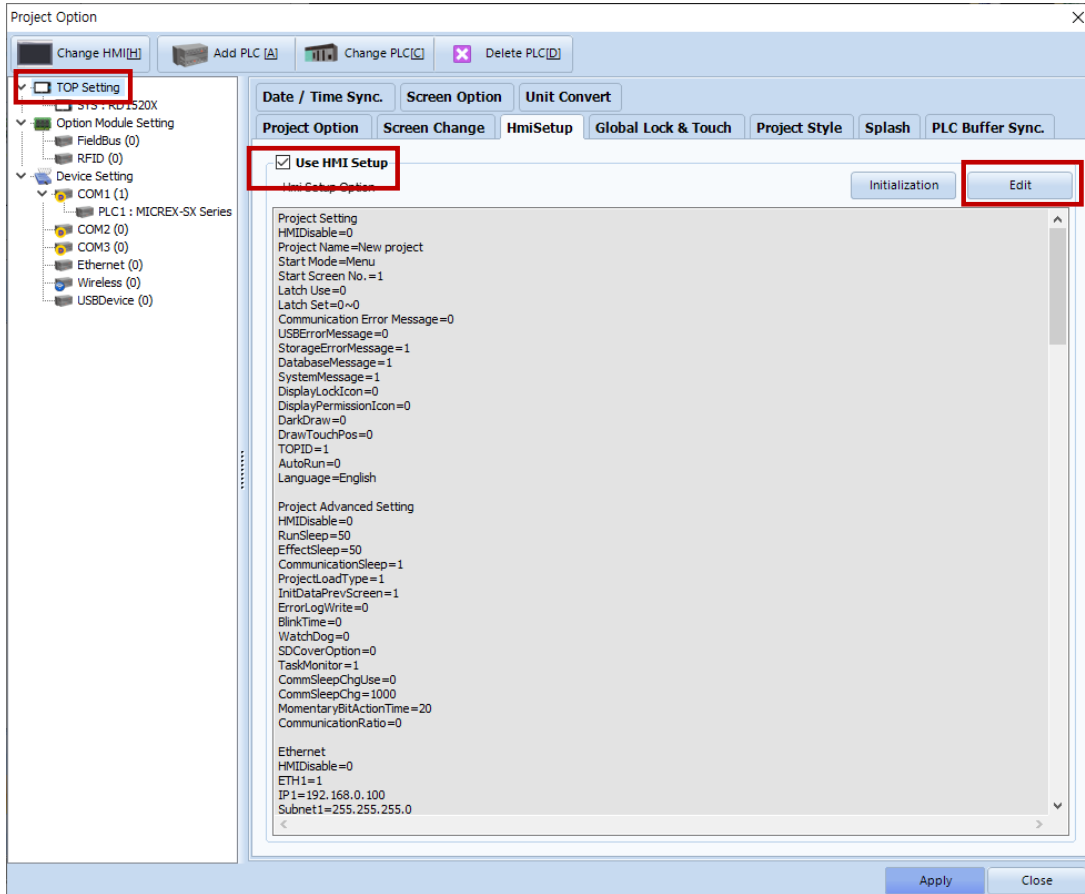


Items	TOP	External device	Remarks
Signal Level (port)	RS-232C	RS-232C (CPU port)	
Baud Rate	9600		
Data Bit	8		
Stop Bit	1		
Parity Bit	Even		

* The above settings are examples recommended by the company.

Items	Description
Signal Level	Select the serial communication method between the TOP and an external device.
Baud Rate	Select the serial communication speed between the TOP and an external device.
Data Bit	Select the serial communication data bit between the TOP and an external device.
Stop Bit	Select the serial communication stop bit between the TOP and an external device.
Parity Bit	Select the serial communication parity bit check method between the TOP and an external device.

(2) Communication option setting

- [Project > Project Property > Device Setting > COM > "PLC1 : MICREX-SX Series"]
 – Set the options of the MICREX-SX Series communication driver in TOP Design Studio.

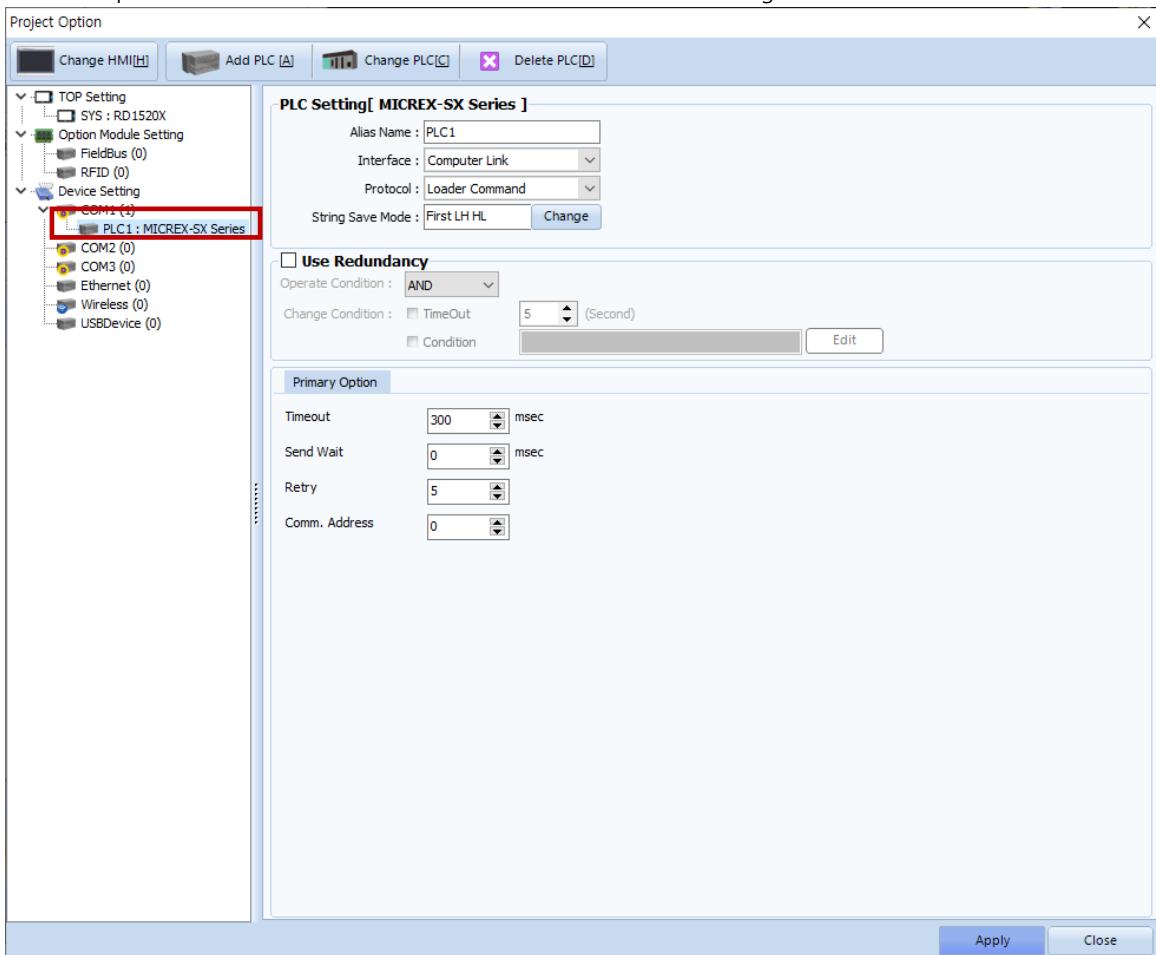

Items	Settings	Remarks
Interface	Select the TOP communication interface.	Refer to "2. External device selection" .
Protocol	Select the TOP communication protocol.	Refer to "2. External device selection" .
TimeOut (ms)	Set the time for the TOP to wait for a response from an external device.	
SendWait (ms)	Set the waiting time between TOP's receiving a response from an external device and sending the next command request.	
Comm. Address	Enters the SX Bus Station number of the external device.	

3.2. Communication setting in TOP


* This is a setting method when "Use HMI Setup" in the setting items in "3.1 TOP Design Studio" is not checked.

- Touch the top of the TOP screen and drag it down. Touch "EXIT" in the pop-up window to go to the main screen.



(1) Communication interface setting

- [Main Screen > Control Panel > Serial]

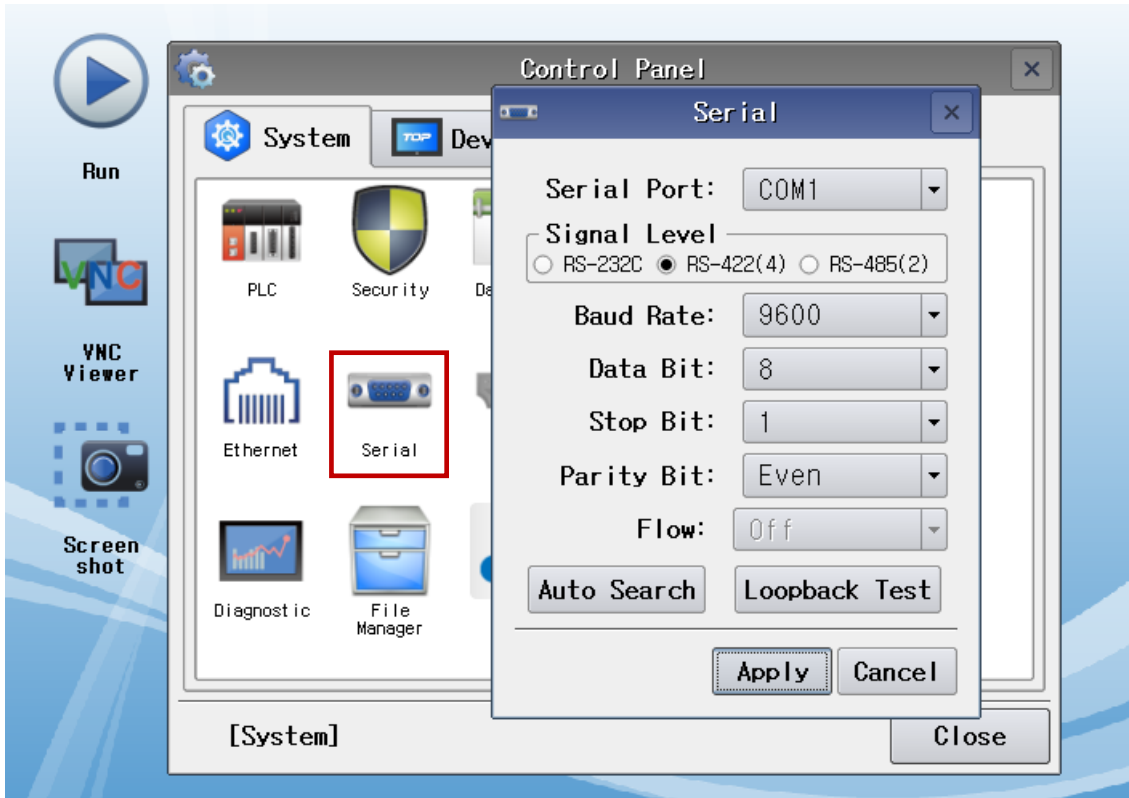


Items	TOP	External device	Remarks
Signal Level (port)	RS-422	RS-422 (CPU port)	
Baud Rate		9600	
Data Bit		8	
Stop Bit		1	
Parity Bit		Even	

* The above settings are setting examples recommended by the company.

Items	Description
Signal Level	Select the serial communication method between the TOP and an external device.
Baud Rate	Select the serial communication speed between the TOP and an external device.
Data Bit	Select the serial communication data bit between the TOP and an external device.
Stop Bit	Select the serial communication stop bit between the TOP and an external device.
Parity Bit	Select the serial communication parity bit check method between the TOP and an external device.

(2) Communication option setting

■ [Main Screen > Control Panel > PLC]

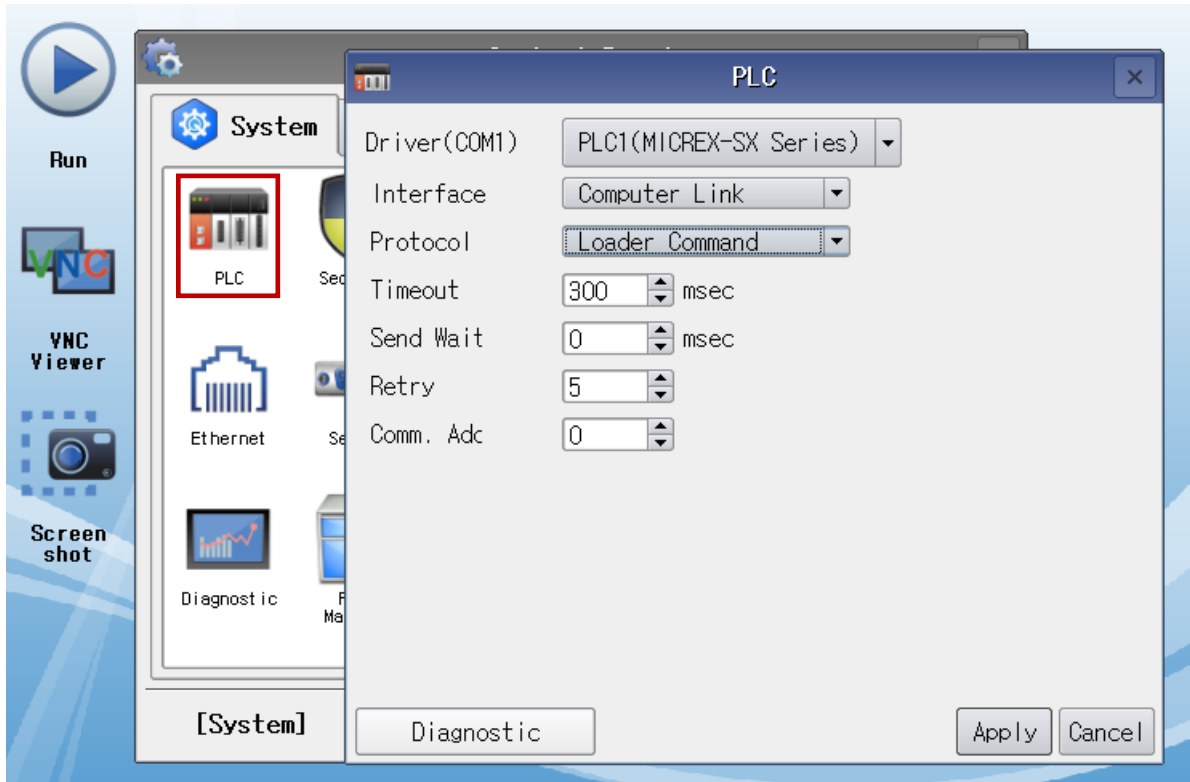

Items	Settings	Remarks
Interface	Select the TOP communication interface.	Refer to "2. External device selection".
Protocol	Select the TOP communication protocol.	Refer to "2. External device selection".
TimeOut (ms)	Set the time for the TOP to wait for a response from an external device.	
SendWait (ms)	Set the waiting time between TOP's receiving a response from an external device and sending the next command request.	
Comm. Address	Enters the SX Bus Station number of the external device.	

3.3 Communication diagnostics

- Check the interface setting status between the TOP and external device.
 - Touch the top of the TOP screen and drag it down. Touch "EXIT" in the pop-up window to go to the main screen.
 - Check if the port (COM1/COM2) settings you want to use in [Control Panel > Serial] are the same as those of the external device.
- Diagnosis of whether the port communication is normal or not
 - Touch "Communication diagnostics" in [Control Panel > PLC].
 - The Diagnostics dialog box pops up on the screen and determines the diagnostic status.

OK	Communication setting normal
Time Out Error	Communication setting abnormal - Check the cable, TOP, and external device setting status. (Reference: Communication diagnostics sheet)

■ Communication diagnostics sheet

- If there is a problem with the communication connection with an external terminal, please check the settings in the sheet below.

Items	Contents	Check		Remarks	
System configuration	How to connect the system	OK	NG	1. System configuration	
	Connection cable name	OK	NG		
TOP	Version information	OK	NG	2. External device selection 3. Communication setting	
	Port in use	OK	NG		
	Driver name	OK	NG		
	Other detailed settings	OK	NG		
	Relative prefix	Project setting	OK		NG
		Communication diagnostics	OK		NG
	Serial Parameter	Transmission Speed	OK		NG
Data Bit		OK	NG		
Stop Bit		OK	NG		
Parity Bit		OK	NG		
External device	CPU name	OK	NG	4. External device setting	
	Communication port name (module name)	OK	NG		
	Protocol (mode)	OK	NG		
	Setup Prefix	OK	NG		
	Other detailed settings	OK	NG		
	Serial Parameter	Transmission Speed	OK		NG
		Data Bit	OK		NG
		Stop Bit	OK		NG
Parity Bit		OK	NG		
Check address range		OK	NG	6. Supported addresses (For details, please refer to the PLC vendor's manual.)	




4. External device setting

Refer to the communication settings manual of the external device for configuration.

5. Cable table

This chapter introduces a cable diagram for normal communication between the TOP and the corresponding device.
 (The cable diagram described in this section may differ from the recommendations of "FUJI Electric Co., Ltd.")

■ RS-422 (1:1 connection)

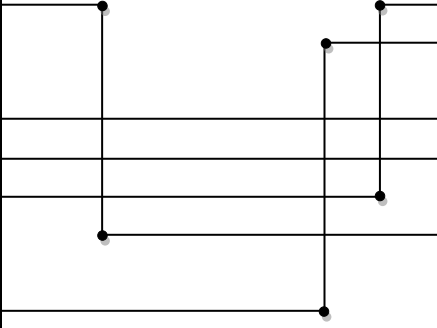COM			Cable connection	MELSEC FX Positioning Controller	
Pin arrangement* Note 1)	Signal name	Pin number		Pin number	Pin arrangement* Note 1)
 <p>Based on communication cable connector front, D-SUB 9 Pin male (male, convex)</p>	RDA	1		1	 <p>Based on communication cable connector front, MINI-DIN 8 Pin male (male, convex)</p>
		2		2	
		3		3	
	RDB	4		4	
	SG	5		5	
	SDA	6		6	
		7		7	
		8		8	
	SDB	9			

***Note 1)** The pin arrangement is as seen from the connecting side of the cable connection connector.

6. Supported addresses

The devices available in TOP are as follows:

The device range (address) may differ depending on the CPU module series/type. The TOP series supports the maximum address range used by the external device series. Please refer to each CPU module user manual and be take caution to not deviate from the address range supported by the device you want to use.

Device	Bit	Word	Double word	Remarks
Input Memory	IX000.00 – IX511.15	IW000 – IW511	ID000 – ID510	
Output Memory	QX000.00 – QX511.15	QW000 – QW511	QD000 – QD510	
Standard Memory	MX1.0.0 – MX1.4999999.15	MW1.0 – MW1.4999999	MD1.0 – MD1.4999998	
Retain Memory	MX3.0.0 – MX3.3388607.15	MW3.0 – MW3.3388607	MD3.0 – MD3.3388606	
System Memory	MX10.0.0 – MX10.65535.15	MW10.0 – MW10.65535	MD10.0 – MD10.65534	